

PSO based tuning of PID controller for a Load frequency control in two area power system

Ranuva Nageswara Rao* P.Rama Krishna Reddy**

*(Department of Instrumentation and control Engineering G. Narayanamma institute of technology & science ,Hyderabad, A.P, India)

***(Department of Instrumentation and control Engineering G. Narayanamma institute of technology & science ,Hyderabad, A.P, India)

Abstract—

The paper deals with optimal tuning of a PID controller for a load frequency control of two area Power system using particle swarm optimization (PSO) algorithm. The proposed approach has superior feature, including easy implementation, stable convergence characteristics and very good computational performances efficiency. The main objective is to obtain a stable ,robust and controlled system by tuning the PID controller using PSO algorithm. The incurred value is compared with the traditional tuning techniques like Ziegler Nichols and is proved better. The interconnected two area LFC system is modeled and simulated using MATLAB-SIMLINK environment and the PID control parameters are tuned based on PSO algorithm. Hence the results establishes that tuning the PID controller using the PSO technique gives less over shoot, system is less sluggish and reduces the integral Time absolute error(ITAE) Particle Swarm Optimization method finds the best parameters for controller and designed controller is an optimal controller.

The studies power system is subjected to a load disturbances to validate the effectiveness of the proposed PSO controller. The simulated results are obtained for different load configurations of the PSO based controller.

Keywords :PSO, Ziegler Nichols, PID controller, ITAE, Load frequency control

I.Introduction

For large scale power systems which normally consist of interconnected control areas,load frequency control (LFC) is important to keep the system frequency and the inter-area tie power as near to the scheduled values as possible. Because loading of a given power system is never constant and to ensure the quality of power supply, a load frequency controller is needed to maintain the system frequency at the desired nominal value. In a deregulated power system, each control area contains different kinds of uncertainties and various disturbances due to increased complexity, system modeling errors and changing power system structureTherefore, a control strategy is needed that not only maintains constancy of frequency and desired tie-power flow but also achieves zero steady state error and inadvertent interchange. Among the various types of load frequency controllers, the most widely employed is the conventional proportional integral (PI) controller.

However, since the “I” control parameters are usually tuned, it is incapable of obtaining good dynamic performance for various load and system change scenarios. Many studies have been carried out in the past about the load frequency control. In literature, some control strategies have been suggested based on the conventional linear control theory [1]. These controllers may be unsuitable in some operating conditions due to the complexity of the power systems such as nonlinear load characteristics and variable operating points. According to [2], conventional PID control schemes will not reach a high degree of control performances.

The popularity of PID controllers is due to their functional simplicity and reliability. They provide robust and reliable performance for most systems and the PID parameters are tuned to ensure a satisfactory closed loop performance [3]. A PID controller improves the transient response of a system by reducing the overshoot, and by shortening the settling time of a system [4]. The PID control algorithm is used to control almost all loops in process industries and is also the cornerstone for many advance control algorithms and strategies. For this control loop to function properly, the PID loop must be properly tuned. Standard methods for tuning include Ziegler-Nichols Ultimate-cycle tuning [5], Cohen-Coon’s [6], Astrom and Hagglund[7] and many other traditional techniques. Although new methods are proposed for tuning the PID controller, their usage is limited due to complexities arising at the time of implementation. Since, Particle Swarm Optimization algorithm is an optimization method that finds the best parameters for controller in the uncertainty area of controller parameters and obtained controller is an optimal controller, it has been used in almost all sectors of industry and science. One of them is the load frequency control [8]. In this study, it is used to determine the parameters of a PID controller according to the system dynamics

The objective of this study is to investigate the load frequency control and inter area tie-power control problem for a multi-area power system taking into consideration the uncertainties in the parameters of system.. An optimal control scheme based particle swarm optimization (PSO)

Algorithm method is used for tuning the parameters of this PID controller. The proposed controller is simulated for a two-area power system. To show effectiveness of proposed method and also compare the performance of these two controllers, several changes in demand of first area, demand of second area and demand of two areas simultaneously are applied. Simulation results indicate that PSO controllers guarantee the good performance under various load conditions.

II. Overview Particle Swarm Optimization

PSO is a population-based optimization method first proposed by Eberhart and Colleagues [9, 10]. Some of the attractive features of PSO include the ease of implementation and the fact that no gradient information is required. It can be used to solve a wide array of different optimization problems. Like evolutionary algorithms, PSO technique conducts search using a population of particles, corresponding to individuals. Each particle represents a candidate solution to the problem at hand. In a PSO system, particles change their positions by flying around in a multidimensional search space until computational limitations are exceeded. This new approach features many advantages; it is simple, fast and can be coded in few lines. Also its strong requirement is minimal. Moreover, this approach is advantageous over evolutionary and genetic algorithm in many ways. First, PSO has memory. That is, every particle remembers its best solution (global best). Another advantage of PSO is that the initial population of the PSO is maintained and so there is no need for applying operators to the population, a process that is time-and memory-storage-consuming. In addition, PSO is based on constructive cooperation between particles, in contrast with the genetic algorithms, which are based on the survival of the fittest[11-14]

Steps of PSO: Steps of PSO as implemented for optimization are[11-14]:

Step 1: Initialize an array of particles with random positions and their associated velocities to satisfy the inequality constraints.

Step 2: Check for the satisfaction of the equality constraints and modify the solution if required.

Step 3: Evaluate the fitness function of each particle.

Step 4: Compare the current value of the fitness function with the particles previous best value (pbest). If the current fitness value is less, then assign the current fitness value to pbest and assign the current coordinates (positions) to pbestx.

Step 5: Determine the current global minimum fitness value among the current positions.

Step 6: Compare the current global minimum with the previous global minimum (gbest). If the current global minimum is better than gbest, then assign the current global

minimum to gbest and assign the current coordinates (positions) to gbestx.

Step 7: Change the velocities.

Step 8: Move each particle to the new position and return to step 2.

Step 9: Repeat step 2-8 until a stop criterion is satisfied or the maximum number of iterations is reached.

PSO and HPSO algorithm definition: The PSO definition is presented as follows[19,22,26]:

- Each individual particle i has the following properties:
 - x_i = A current position in search space.
 - v_i = A current velocity in search space.
 - y_i = A personal best position in search space.
- The personal best position p_i corresponds to the position in search space, where particle i presents the smallest error as determined by the objective function f , assuming a minimization task.
- The global best position denoted by g represents the position yielding the lowest error among all the p_i 's.

Equation 2 and 3 define how the personal and global best values are updated at time k , respectively. In below, it is assumed that the swarm consists of s particles. Thus,

During each iteration, every particle in the swarm is updated using 4 and 5. Two pseudorandom sequences $r_1 \sim U(0,1)$ and $r_2 \sim U(0,1)$ are used to affect the stochastic nature of the algorithm.

Where

Velocity of i th particle at k th iteration.

Velocity of i th particle at $(k+1)$ th iteration

Inertia weight

Position of i th particle at k th iteration

Position of i th particle at $(k+1)$ th iteration.

c_1, c_2 = Positive constants both equal to 2.

iter, itermax = Iteration no: and maximum iteration no:

rand(1), = Random no: selected between 0 and 1

rand(2).

Evolutionary operators such as selection, crossover and mutation have been applied into the PSO. By applying selection operation in PSO, the particles with the best performance are copied into the next generation, therefore, PSO can always keep the best performed particles. By applying crossover operation, information can be exchanged or swapped between two particles so that they can fly to the new search area as in evolutionary programming and genetic algorithms. Among the three evolutionary operators, the mutation operators are the most commonly applied evolutionary operators in PSO. The purpose of applying mutation to PSO is to increase the diversity of the population and the ability to have the PSO to escape the local minima[11-14].

The objective of the paper is to use the PSO algorithm in order to obtain optimal PID controller settings for a two area load frequency system. Every possible controller setting represent a particle in the search space which changes its parameters proportionality constant, K_p , integral constant, K_i , and derivative constant K_d in order to minimize the error function (objective function in this case). The error function used here is Integral Time of Absolute errors (ITAE), Integral. The model of two area power system is given in section 3. The tuning results of conventional techniques are discussed in section 4. And 5 deal with the explanation of the PSO algorithm and its implementation. The comparative studies and results are given in Section 6. The conclusions arrived, based on the results is given in Section 7 followed by conclusion and reference in section 7 and 8 respectively.

III. MODEL OF TWO –AREA INTERCONNECTED POWER SYSTEM

Basically, Two area power system consists of a governor, a turbine and a generator with feedback of regulation constant. System also includes step load change input to the generator. This work mainly related with the controller unit of a two area power system. Simple block diagram of a two area power system with the controller is shown in Figure 1, where $\Delta f 1$ and $\Delta f 2$ are the frequency deviations in area 1 and area 2 respectively in Hz. $\Delta P d 1$ and $\Delta P d 2$ are the load demand increments. In most of the studies earlier the researchers have used the dynamic model of the power system given by O. I. Elgerd[15].

The area control error (ACE) for the i th area is defined as:

with PID controller, the conventional automatic generation controller has a control equation of the form 9.

Where K_p, K_i, K_d are the gains of the proportional, integral and derivative controllers for the i th area.

To simplify the analysis, the two interconnected areas were considered identical. The optimal parameter values are such that: $K_{p1} = K_{p2} = K_p$ and $K_{i1} = K_{i2} = K_i$ and $K_{d1} = K_{d2} = K_d$

The nominal system parameters are given in appendix. The performance index considered in this study is of the form:

The framework of PSO based self-tuning PID controller is depicted as Figure 2. To find the optimum parameters (K_p, K_i, K_d) of PID controller, PSO program should search in 3-dimensional search space. With the optimized parameters based on PSO algorithm, the proposed PID controller of the LFC can achieve optimal properties. The block diagram of a two area power system with this controller is shown in Figure 2. The two area power system parameters are given in Table 1.

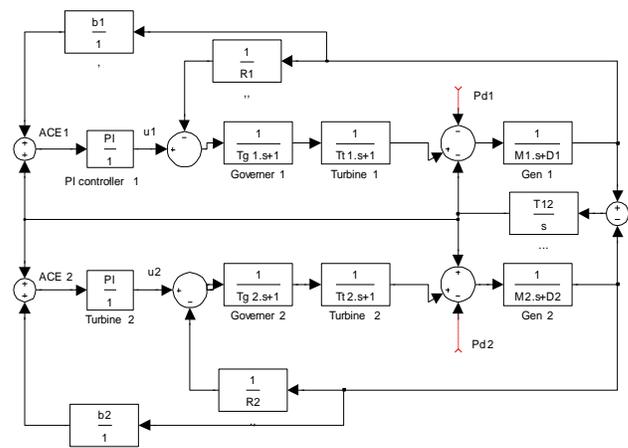


Fig.1 block diagram of a two area power system with the controller

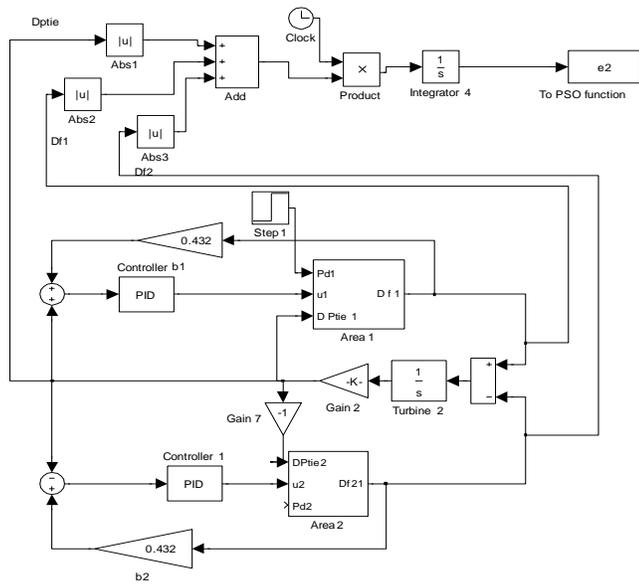


Fig.2 block diagram of a two area power system with the optimal controller and PSO function

Table 1: Parameters of the two area power system

Area 1 and Area 2
Parameters are as follows: $f = 50 \text{ Hz}$, $R1 = R2 = 2.4 \text{ Hz/ per unit MW}$, $Tg1 = Tg2 = 0.08 \text{ sec}$, $Tp1 = Tp2 = 20 \text{ sec}$, $P \text{ tiemax} = 200 \text{ MW}$, $Pr1 = Pr2 = 2000 \text{ MW}$, $Tt1 = Tt2 = 0.3 \text{ sec}$, $Kp1 = Kp2 = 120 \text{ Hz.p.u/MW}$,

IV .Conventional Design Technique

Over the last fifty years, numerous methods have been developed for setting the parameters of a PID controller. In this paper the the PSO tuning technique is compared with Ziegler Nichols [4] tuning method. In the 1940's, Ziegler and Nichols devised two empirical methods for obtaining controller parameters. The Ziegler-Nichols closed-loop tuning method allows you to use the ultimate gain value, Ku, and the ultimate period of oscillation, Pu, to calculate Kc . It is a simple method of tuning PID controllers and can be refined to give better approximations of the controller. Even though this method was devised in 1940, it is still one of the most widely used methods of tuning a PID controller because of its applicability to almost all the systems irrespective of its order. Although many other

methods of tuning are being developed in this field in recent years not many have proved to be as efficacious as the above mentioned one. The ultimate gain value for the above mentioned system has been calculated to be $Ku = 1.16$ and the ultimate period of oscillation is $Pu = 1.33$. Based on Ziegler-Nichols tuning method the tuning parameters has been calculated to be $Kp = 0.68235$ $Ki = 0.6265$ $Kd = 0.16625$. The frequency response of the system with PID tuned with Ziegler-Nichols has been compared with our method of tuning in the forthcoming paragraphs.

V .CONTROLLER DESIGN USING PSO ALGORITHM

The PID controller optimized by PSO is designed for LFC and tie-power control. The goals are control of frequency and inter area tie-power with good oscillation damping, also obtaining a good performance. In this study, the optimum values of the parameters KP KI and Kd for PID controller is easily and accurately computed using a PSO. In a typical run of the PSO, an initial population is randomly generated. This initial population is referred to as the 0th generation. Each individual in the initial population has an associated performance index value. Using the performance index information, the PSO then produces a new population. In order to obtain the value of the performance index for each of the individuals in the current population, the system must be simulated. The PSO then produces the next generation of individuals using the reproduction crossover and mutation operators. These processes are repeated until the population is converged and optimum value of parameters found.

VI .RESULTS AND COMPARISION

During the simulation study, error signals s Df1,Df2 and tie line power which is required for the controller is transferred to PSO software. All positions of particles on each dimension are clamped in limits which are specified by the user, and the velocities are clamped to the range [vmin., vmax.] given as [15]:

a step increase in demand of 0.01 p.u is applied to area 1. The frequency deviation of the first area Df1 and the frequency deviation of the second area Df2 and inter area tie-power signals of the closed-loop system are shown in Fig. 3 ,4 and 5. Similarly a step increase in demand of 0.01 is applied to area2. frequency deviation of the first area Df1 and the frequency deviation of the second area Df2 and inter area tie-power signals of the closed-loop system are shown in Fig. 6-8.

Simulation results show performance improvement in time domain specifications for a step load of 0.01 p.u.

Table 2: System performances for conventional PID controller and proposed controller for 1% load at Area 1

Controller	Change in frequency in Area 1		Change in frequency in Area 2		Change in tie line power	
	Settling time (sec)	Max deviation (p.u)	Settling time (sec)	Max deviation (p.u)	Settling time (sec)	Max deviation (p.u)
Ziegler PID	10	0.0164	10.2	0.0113	8.4	0.0037
PSO PID	3.9	0.0115	2.6	0.0065	2.6	0.00237

Table 3: System performances for conventional PID controller and proposed controller for 1% load at Area 2

Controller	Change in frequency in Area 1		Change in frequency in Area 2		Change in tie line power	
	Settling time (sec)	Max deviation (p.u)	Settling time (sec)	Max deviation (p.u)	Settling time (sec)	Max deviation (p.u)
Ziegler PID	10	0.0113	9.4	0.0164	8.4	0.00378
PSO PID	3.8	0.0098	3	0.0149	2.6	0.002357

Using the PSO approach, global and local solutions could be simultaneously found for better tuning of the controller parameters. The PID value which was obtained by the PSO algorithm is compared with that of the one derived from Zeigler-Nichols method in various perspectives, namely robustness and stability. performances. All the simulations were implemented using MATLAB

A comparison of time domain specifications peak overshoot, peak time, rise time and settling time for a step load of 0.01 p.u at area 1 are tabulated as given in table (2).and It is found very clearly that the PSO based controller drastically reduces the overshoot by a large value. Settling time, Rise Time and Peak Time have also improved. Henceforth outperforms that of the traditionally tuned controller with Zeigler- Nichols criterion.

Similarly for a step change of 0.01 p.u at area2 are tabulated in Table 3. At the simulation, the number of generations is taken 10 and the population size is taken 5. c1 and c2 constants are taken as 0.12 and 1.2

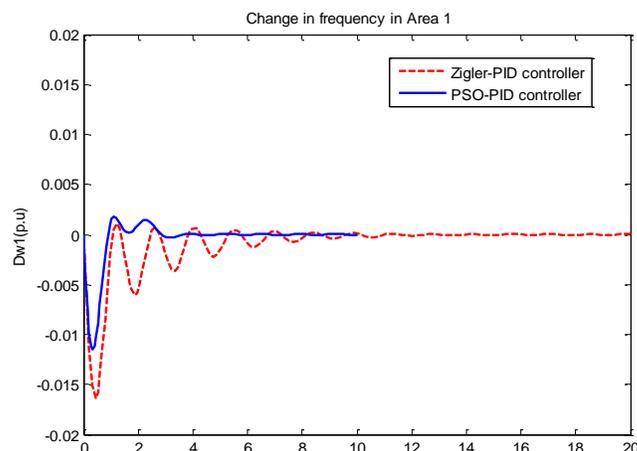


Fig.3.Change in frequency in area 1 for a step load of 1% at area 1

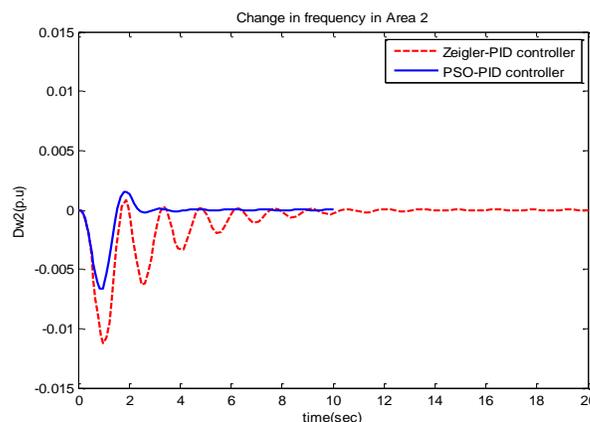


Fig 4. Change in frequency in area 2 for a step load of 1% at area 1

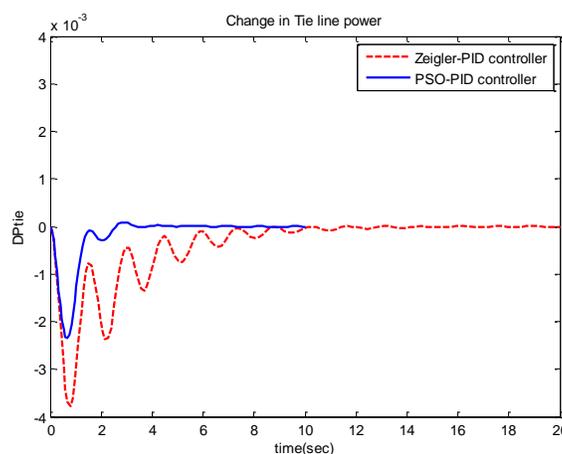


Fig 5.Change in tie line power for a step load of 1% at area1

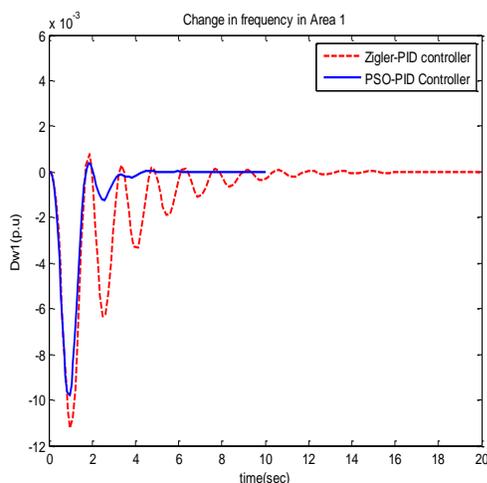


Fig 6. Change in frequency in area 1 for a step load of 1% at area 2

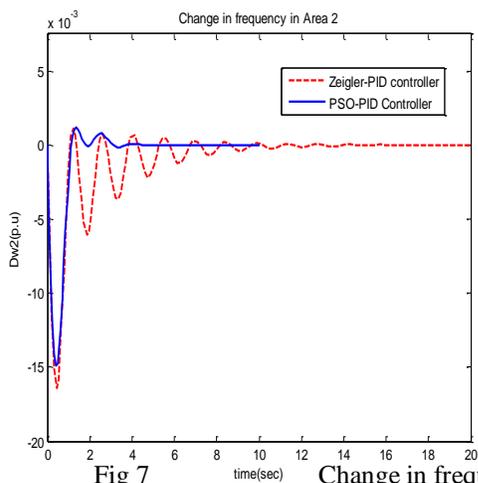


Fig 7 Change in frequency in area 2 for a step load of 1% at area 2

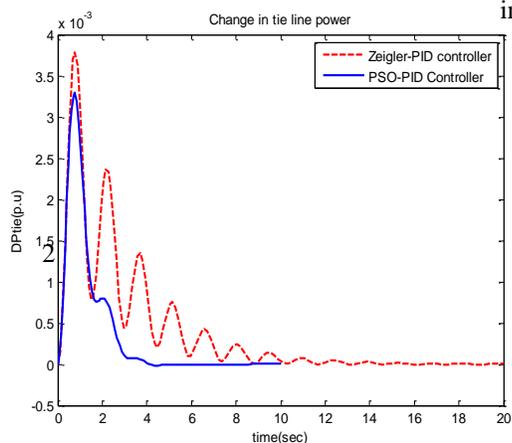


Fig 8. Change in tie line power for a step load of 1% at area 2

VII. CONCLUSION.

In this study, a new particle swarm optimized LFC has been investigated for automatic load frequency control of a two area power systems. It is shown analytically and graphically that there is a substantial improvement in the time domain specification in terms of lesser rise time, peak time, settling time as well as a lower overshoot. The proposed controller using PSO algorithm is proved to be better than the controller tuned by Ziegler Nichols method. Therefore, the proposed PSO-PID controller is recommended to generate good quality and reliable electric energy. In addition, the proposed controller is very simple and easy to implement since it does not require many information about system parameters. comparison of the proposed PSO-PID controller with fuzzy PID controllers will be subject to the future work.

VIII. REFERENCES AND CITATIONS

1. A.Kumar, O.P.Malik, G.S.Hope, *Variablestructure-system control applied to AGC of aninterconnected power system*, IEE Proceedings, Vol. 132, Pt. C, No. 1, pp. 23-29, January 1985.
2. Unbehauen, H., Keuchel, U., Kocaarslan, I., *Real-Time Adaptive Control of Electrical Power and Enthalpy for a 750 MW Once-Through Boiler*, Proceedings of IEE International Control Conference 91, Edinburg, Scotland, Vol.1, pp. 42-47, 25-28 March 1991.
3. Kim Dong Hwa and Park Jin Ill: *Intelligent PID Controller Tuning of AVR system using GA and PSO* Springer-Verlag Berlin Heidelberg: ICIC 2005, Part II, LNCS 3645, pp 366-375.(2005).
4. K.J.Astrom, T.Hagglund, *The future of PIDcontrol*, Control Eng.Pract.9(11)(2001)1163-1175.
5. Ziegler, G. and Nichols, N. B, 1942.Optimum settings for automatic controllers, Trans. ASME, 64,759-768.
6. G.H Cohen and G.A Coon: *Theoretical Consideration of Retarded Control* , Trans ASME 75,pp.827/834,(1953)
7. Astrom, K J.; Hagglund .T,1984, *Automatic tuning of simple regulators with specifications on phase and amplitude margins*, Automatica, 20,645-651.
8. Taher, S.A., Hemati, R., Abdolalipour, A., Tabie, S.H., *Optimal Decentralized Load Frequency Control Using HPSO Algorithms in Deregulated Power Systems*, American Journal of Applied Sciences 5 (9): 1167-1174, 2008.
9. Kennedy, J., Eberhart, R.C., *Particles Swarm Optimization*, Proc. IEEE International Conference on Neural Networks, Perth Australia, IEEE Service Center, Piscataway, NJ, IV:1942-1948, 1995.
10. Eberhart, R.C., Kennedy, J., *A New Optimizer Using Particles Swarm Theory*, Proc. Sixth International Symposium on Micro Machine and Human Science, Nagoya-Japan, IEEE Service Center, Piscataway, NJ, 39-43, 1995.

11. Al-Awami, A.T. *at al.*, 2007. A particle-swarmbased approach of power system stability enhancement with UPFC. *Elec. Power and Energy Syst.*, (29): 251-259.
12. Miranda, V. and N. Fonseca, 2002. New evolutionary particle swarm algorithm (EPSO) applied to voltage/VAR control. The 14th PSCC Conf. (PSCC'02-2002), Seville, Spain.
13. . Blackwell, T. and P.J. Bentley, 2002. Don't push me! Collision-avoiding swarms. *IEEE Cong. On Evol. Comput.*, Honolulu, Hawaii USA.
14. Krink, T., J.S. Vesterstrøm and J. Riget, 2002. PSO with spatial particle extension, *Proc. of the 4th Congress on Evol. Comput.*, (CEC-2002).
15. Fosha C.E., Elgerd O.I., The megawatt – frequency control theory, *IEEE Trans. Power Appl. Syst.* (1970) Vol.89, pp. 563 – 571.
16. Chen, J., Ren, Z., Fan, X., *Particle Swarm Optimization With Adaptive Mutation And Its Application Research In Tuning Of PID Parameter*, IEEE, 2005.

Biography:



Ranuva Nageswara Rao received the M.Tech degree in electrical and electronics engineering from Sri venkateswara University college of Engineering, Tirupathi, Andhra Pradesh, India in 2000. Currently he is an associate professor at G.N.I.T.S, Hyderabad, INDIA his interests are Power system control, High voltage engineering



P.Rama Krishna Reddy received the M.Tech degree in electrical and electronics engineering from Sri venkateswara University college of Engineering, Tirupathi, Andhra Pradesh, India in 2000. Currently he is an associate professor at G.N.I.T.S, Hyderabad, INDIA his interests are Power system control, High voltage Engineering