

Power Quality Improvement And Mitigation Of Voltage Sag And Current Swell Using Distributed Power Flow Controller

P.NIRMALA¹, SK.SAJIDA², SK.JAN BHASHA³,

PG Student [EPS], Dept. of EEE, ASIT, Gudur, SPSR Nellore (D), Andhra Pradesh, India¹

Assistant Professor, Dept. of EEE, ASIT, Gudur, SPSR Nellore (D), Andhra Pradesh, India²

Associate Professor, Dept. of EEE, ASIT, Gudur, SPSR Nellore (D), Andhra Pradesh, India³

Abstract—

Modern power utilities have to respond to a number of challenges such as growth of electricity demand specially in non-linear loads in power grids, consequently, That higher power quality should be considered. In this paper, DPFC which is similar to unified power flow controller (UPFC) in structure, which is used to mitigate the voltage sag and swell as a power quality issue. Unlike UPFC, the common dc-link in DPFC, between the shunt and series converter devices should be eliminated and three-phase series converter is divided to several single-phase series distributed converters through the power transmission line. And also to detect the voltage sags and find out the three single-phase reference voltages of DPFC, the synchronous reference frame method is proposed. Application of DPFC in power quality enhancement is simulated in Mat lab/Simulink environment which show the effectiveness of the proposed structure

Index Terms—FACTS, power quality, sag and swell mitigation, distributed power flow controller.

I. INTRODUCTION

Recent developments in the electric utility industry are encouraging the entry of power quality issue [1]. Extending from the generation units to the utility customers, power quality is a measure of how the elements affect the system as a whole [2]. From customer point of view, the power quality issue is concerned about current, voltage or frequency deviation which results in power failure [3]. To solve the power quality problem in such a situation, the power electronic devices such as flexible alternating-current transmission system (FACTS) and custom power devices (DVR) which are used in transmission and distribution control, respectively, should be developed [4], [5], [6]. The impact of transient parameters in majority of transmission lines problems such as sag (voltage dip), swell (over voltage) and interruption, are also considerable [1]. To mitigate the mentioned power quality problems, the utilization of FACTS devices such as power flow controller (UPFC) and synchronous static compensator (STATCOM) can be helpful [7], [8]. In [9], the distributed power flow controller (DPFC) is presented which has a similar configuration to UPFC structure. As shown in Fig. 1, the DPFC is composed of a single shunt converter and multiple independent series converters which is used to balance the line parameters, such as line impedance, transmission angle and bus voltage magnitude [9], [10]. To detect the voltage sags and determine the three single-phase reference voltages of DPFC, the SRF method is also proposed as a detection and determination method. The work in this

paper is organized as follows: the DPFC operation principle is debated in Section II. In Section III, the control strategy of DPFC based on SRF method is proposed. The impact of DPFC in power quality enhancement is investigated in Section IV. Finally, the case study and its simulation results are analyzed in the last part of this work.

II. DPFC STRUCTURE

The basic issues in DPFC principle are DC-link elimination and using 3rd-harmonic current to active power exchange. In the following subsections, the DPFC basic concepts are explained.

A. Eliminate DC-Link and Power Exchange

Within the DPFC, the transmission line is used as a connection between shunt converter output and AC port of series converters, instead of using DC-link for power exchange between converters. The method of power exchange in DPFC is based on power theory of non-sinusoidal components [9]. Non-sinusoidal voltage and current can be presented as the sum of sinusoidal components at different frequencies. It is the main result of Fourier analysis. The product of voltage and current components provides the active power. Since the integral of some terms with different frequencies are zero, so the active power equation is as follow:

$$p = \sum_{i=1}^{\infty} V_i I_i \cos \phi_i \quad (1)$$

Where V_i and I_i are the voltage and current at the i^{th} harmonic frequency, respectively, and ϕ_i is the angle

between the voltage and current at the same frequency. Equation. 1 expresses the active powers at different frequencies are independent from each others. Thus, the converter can absorb the active power in one frequency and generates output power in another frequency. Assume the DPFC is located in transmission line of a two-bus system; therefore, the power supply generates the active power and the shunt converter absorbs it in fundamental frequency of current. Meanwhile, the third harmonic component

is trapped in Y-Δ transformer. Output terminal of the shunt converter injects the third harmonic current into the neutral of Δ-Y transformer.

Consequently, the harmonic current flows through the transmission line. This harmonic current controls the dc voltage of series capacitors. Fig. 2 illustrates how the active power is exchanged between the shunt and series converters in the DPFC.

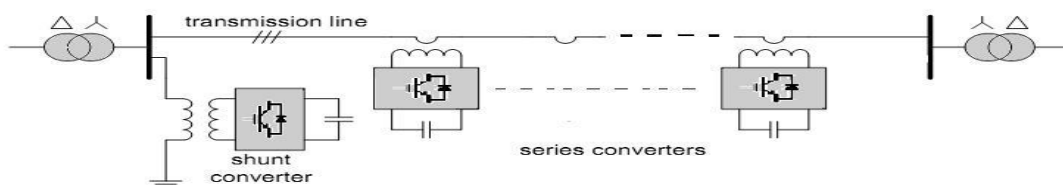


Fig. 1. The DPFC structure.

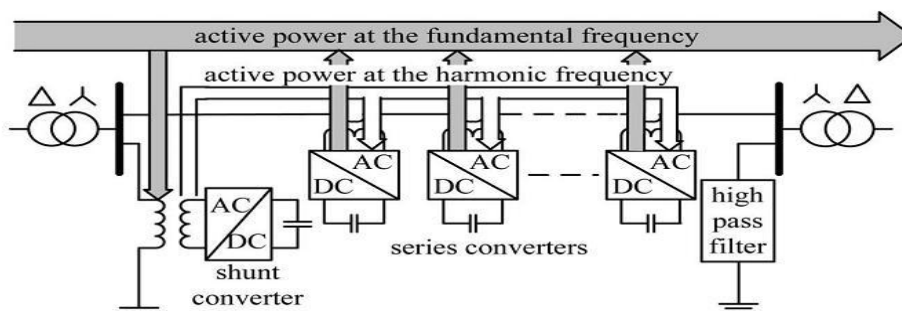


Fig. 2. Active power exchange between DPFC converters.

B. The DPFC Advantages

The DPFC in comparison with UPFC has some advantages, as follows:

1) High control capability.

The DPFC can control all parameters of transmission network: line impedance, transmission angle and bus voltage magnitude.

2) High reliability.

The series converters redundancy increases the DPFC reliability during converters operation [10]. It means, if one of series converters fails, the others can continue to work.

3) Low cost.

The single-phase converters rating, in comparison with three-phase converters is very low. Furthermore, the series converters, in this configuration, no need to any voltage isolation to connect in line. We can use the single turn transformers for series converters hanging. To explore the feasibility of the DPFC, a case study which is to use DPFC to replace UPFC of the Korea electric power corporation (KEPCO) is investigated. To achieve the same control capability as the UPFC, the DPFC construction requires less material [9].

III. DPFC CONTROL BASED ON SRF METHOD

The DPFC has three control strategies: central controller, series control and shunt control, as shown in Fig. 3.

A. Central Control

This controller manages all the series and shunt controllers and sends reference signals to both of them.

B. Series Control

Each single-phase converter has its own series control through the line. This controller inputs are series capacitor voltages, line current and series voltage reference in dq-frame. Any series controller has one low-pass and one 3rd-pass filter to create fundamental and third harmonic current respectively. Two single-phase phase lock loop (PLL) are used to take frequency and phase information from network [11]. The simulated diagram of

series controller is shown in Fig. 4

C. Shunt Control

The shunt converter includes a three-phase converter which is back-to-back connected to a single-phase converter

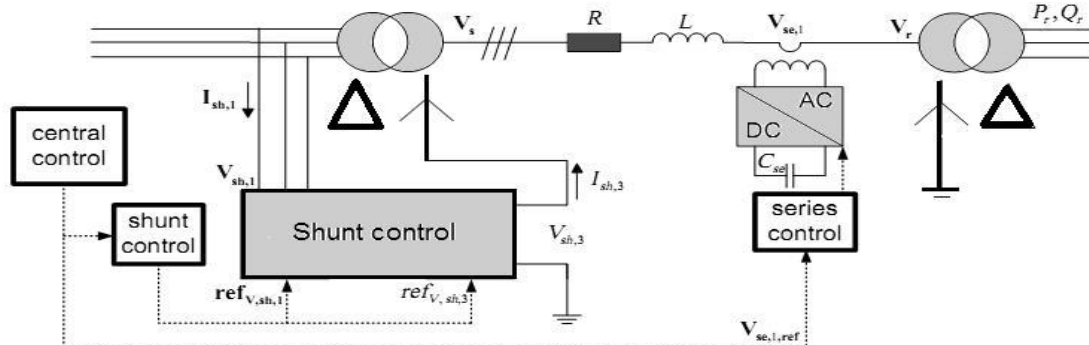


Fig. 3. DPFC Control Structure.

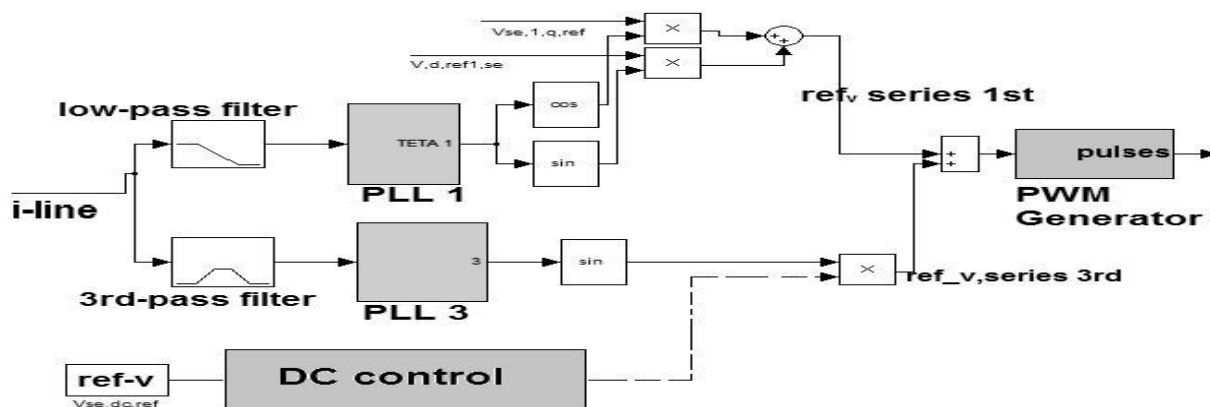


Fig. 4. The series control structure.

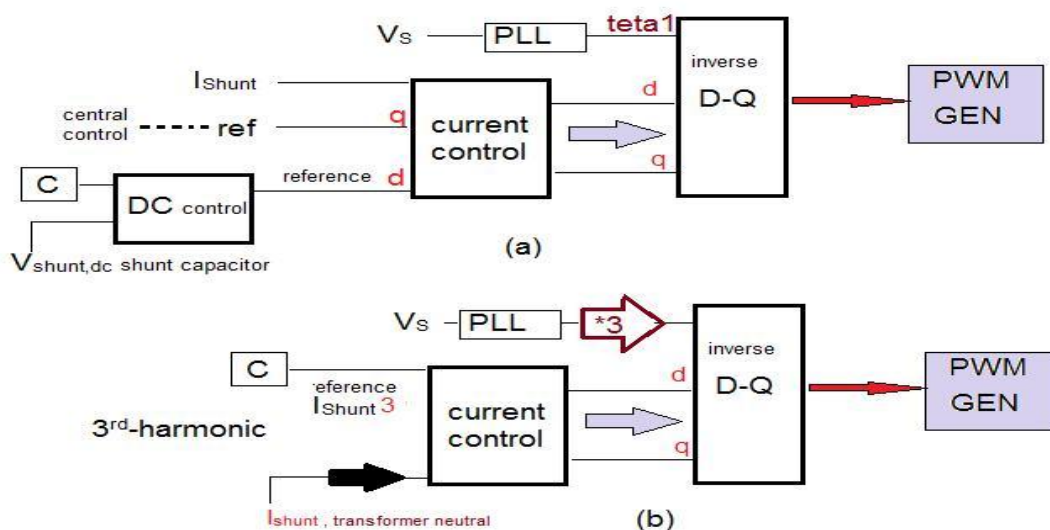


Fig. 5. The shunt control configuration: (a) for fundamental frequency (b) for third-harmonic frequency

The three-phase converter absorbs active power from grid at fundamental frequency and controls the dc voltage of capacitor between this converter and single-phase one. The shunt control structure block diagram is shown in Fig. 5.

D. Proposed Detection and Determination Methods

To detect the voltage sags and determine the three single phase reference voltages of DPFC, the SRF method is introduced as a detection and determination method. The line-to-neutral voltages of grid in the pre-sag state are converted from *abc* coordinate system to SRF (*dq0*) as the first step of this method. Then, the *dq0* values of actual and reference line-neutral grid voltages are compared which the existence of the difference between them is representation of voltage sag and considered as the *dq0* values of DPFC desired injected voltages.

$$V_{dpfc}^{ref} = V_{grid,d}^{ref} - V_{grid,d} \quad (2)$$

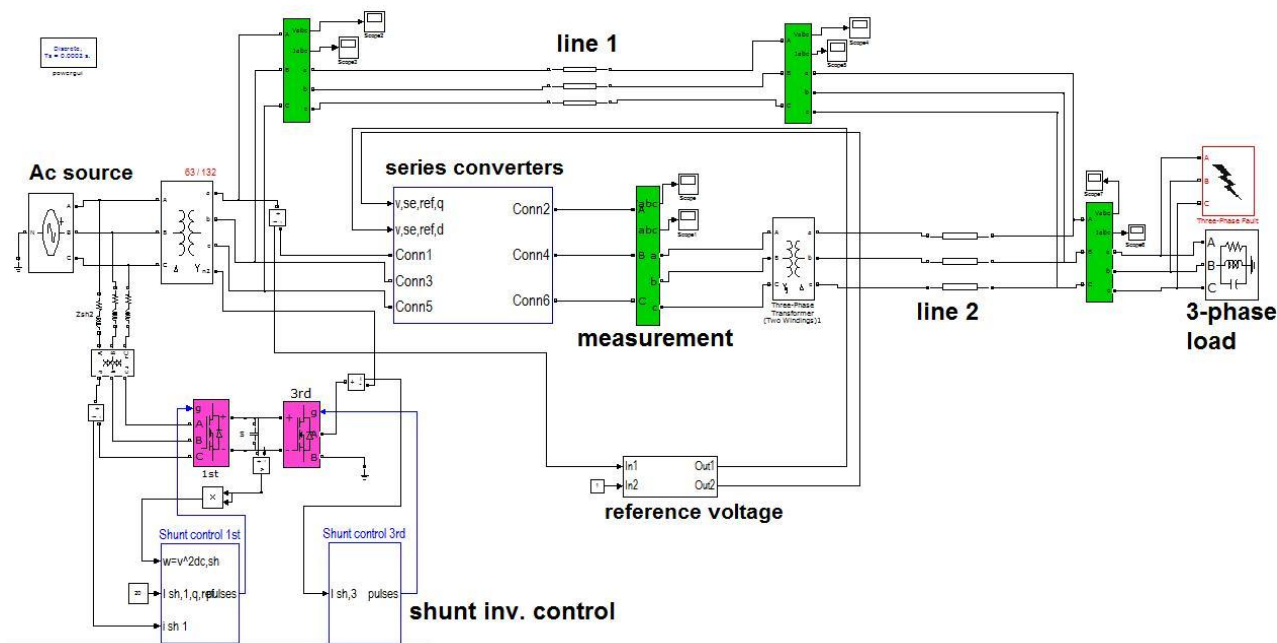


Fig.6.simulated model of the DPFC

$$V_{dpfc,q}^{ref} = V_{grid,q}^{ref} - V_{grid,q} \quad (3)$$

are the reference *dq*- component of DPFC desired injected voltages in the SRF, respectively. fig. 6. Simulated model of the

IV. POWER QUALITY ENHANCEMENT

This modeling has been developed using Mat lab/Simulink environment as shown in Fig. 6. The system is simulated with a three-phase source connected to a non-linear load. The simulation parameters are listed in Table 1. The supply is connected to load through the parallel transmission lines including the transmission line 1 and 2. The parallel transmission lines have same length. The DPFC is incorporated in transmission line 2. For analyzing dynamic performance, the inductive and capacitive loads are connected. The fault should be connected near the load to receive transient analysis. The shunt three-phase converter is connected to the transmission line 2 in parallel through a Y-Δ three-phase transformer, and series converters are distributed through this line.

V. SIMULATION RESULTS

The case study, considering sag/swell condition is implemented in single machine infinite bus system and analyzed results are as follows. To analyze voltage dip, a three-phase fault near the system load, as shown in Fig. 6 is created. The time duration for this fault is 0.5 seconds (500-1000 ms). The three-phase fault causes observable voltage sag during this time, as shown in Fig. 7. The voltage sag value is about 0.5 per unit. The DPFC can compensate the load voltage sag effectively. The voltage sag mitigation with DPFC is shown in Fig. 8.

After creating three-phase fault, Fig. 9 depicts the load current swell around 1.1 per unit. The fault time duration is

0.5 seconds. In this case, after implementation of the DPFC, the load current magnitude is comparatively come down. The current swell mitigation for this case can be observed from Fig. 10.

The load voltage harmonic analysis, using fast Fourier transform (FFT) of power GUI window by *Simulink*, as shown in Fig. 11. It can be seen, after DPFC implementation in system, the odd harmonics are reduced within acceptable limits and total harmonic distortion (THD) of load voltage is minimized.

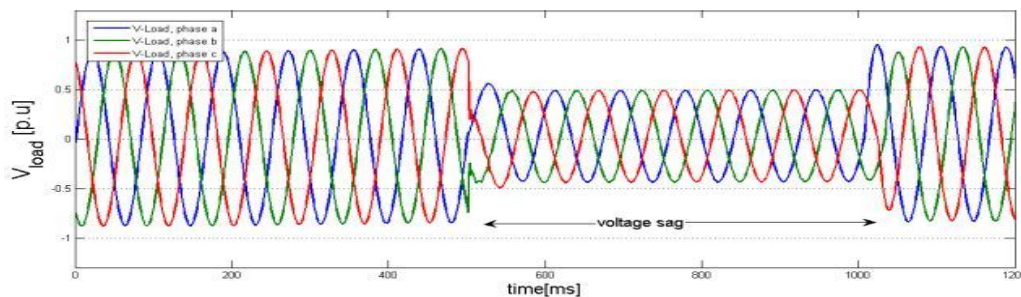


Fig. 7. Three-phase load voltage sag waveform

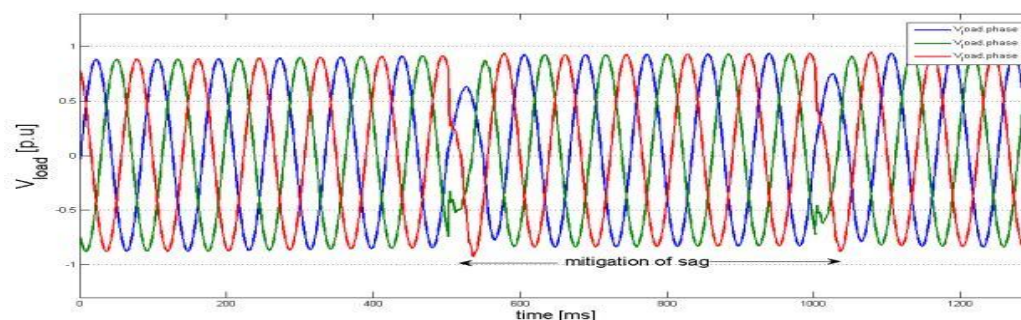


Fig. 8. Mitigation of three-phase load voltage sag with DPFC.

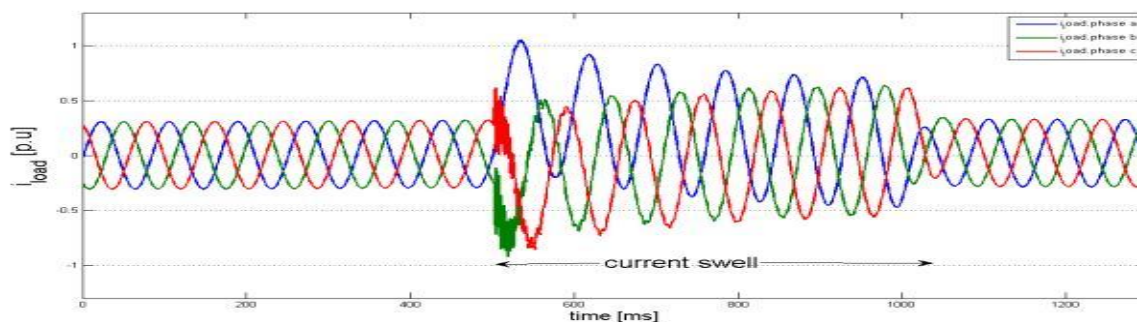


Fig. 9. Three-phase load current swell waveform

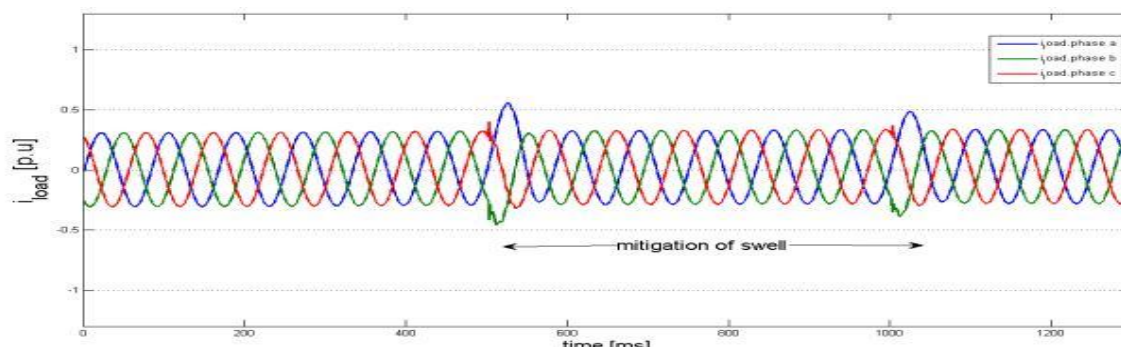


Fig. 10. Mitigation of load current swell with DPFC.

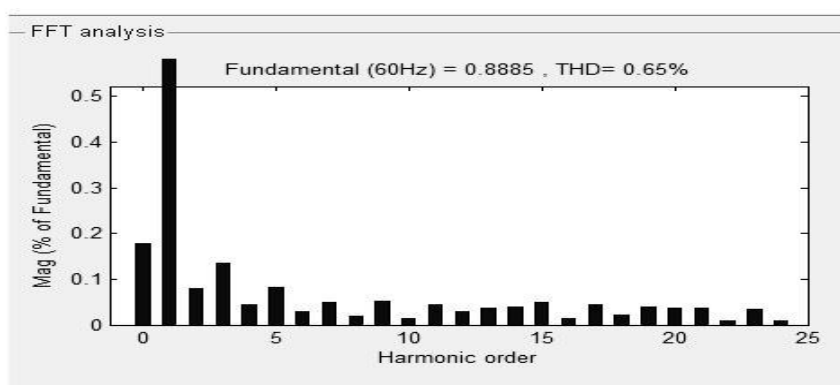


Fig. 11. The load voltage THD.

VI. CONCLUSION

The power quality enhancement of the power transmission systems is an vital issue in power industry. In his study, the application of DPFC as a new FACTS device, in the voltage sag and swell mitigation of a system composed of a three-phase source connected to a non-linear load through the parallel transmission lines is simulated in Matlab/Simulink environment. The voltage dip is analyzed by implementing a three-phase fault close to the system load. To detect the voltage sags and determine the three single phase reference voltages of DPFC, the SRF method is used as a detection and determination method. The obtained simulation results show the effectiveness of DPFC in power quality enhancement, especially in sag and swell mitigation.

TABLE I : THE SIMULATED SYSTEM PARAMETERS.

Parameters	values
Three phase source	
Rated voltage	230 [kV]
Rated power/Frequency	100[mW]/60[HZ]
X/R	3
Short circuit capacity	11000[MW]
Transmission line	
Resistance	0.012 [p.u./km]
Inductance/Capacitance reactance	0.12/0.12[p.u./km]
Length of transmission line	100 [km]

REFERENCES

- [1.] J. Faiz, G. H. Shahgholian, and M. Torabian, "Design and simulation of UPFC or enhancement of power quality in transmission lines," *IEEE International Conference on Power System Technology*, vol. 24, no. 4, 2010.
- [2.] E. Emanuel and J. A. McNeill, "Electric power quality," *Annu. Rev. Energy Environ*, 1997.
- [3.] N. R. Patne and K. L. Thakre "Factor affecting characteristics of voltage sag due to fault in the power system," *Serbian Journal of Electrical engineering*. vol. 5, no.1, 2008.
- [4.] J. R. Enslin, "Unified approach to power quality mitigation," in *Proc. IEEE Int. Symp. Industrial Electronics (ISIE '98)*, vol. 1, 1998.
- [5.] B. Singh, K. Al-Haddad, and A. Chandra, "A review of active filters for power quality improvement," *IEEE Trans. Ind. Electron.* vol. 46, no. 5, pp. 960–971, 1999.
- [6.] M. A. Hannan and A. Mohamed, member IEEE, "PSCAD/EMTDC simulation of unified series- shunt compensator for power quality improvement," *IEEE Transactions on Power Delivery*, vol. 20, no. 2, 2005.
- [7.] L. Olimpo and E. Acha, "Modeling and analysis of custom power systems by PSCAD/EMTDC," *IEEE*

Trans. Power Delivery, vol. 17, no.1, pp. 266–272, 2002.

- [8.] P. Pohjanheimo and E. Lakervi, “Steady state modeling of custom power components in power distribution networks,” in *Proc. IEEE Power Engineering Society Winter Meeting*, vol. 4, Jan, pp. 2949–2954, 2000.
- [9.] Z. H. Yuan, S. W. H de Haan, B. Frreira, and D. Cevoric, “A FACTS device: Distributed power flow controller (DPFC),” *IEEE Transaction on Power Electronics*, vol.25, no.10, October, 2010.
- [10.] Z. H. Yuan, S. W. H de Haan, and B. Frreira “DPFC control during shunt converter failure,” *IEEE Transaction on Power Electronics* 2009.
- [11.] R. Zhang, M. Cardinal, P. Szczesny, and M. Dame. “A grid simulator with control of single-phase power converters in D.Q rotating frame,”



P.Nirmala was born in Andhra Pradesh, India. She received the B.Tech degree in Electrical and Electronics Engineering from JNTU, Anantaapur in 2011 and pursuing M.Tech degree in Power Systems from JTNU, Anantapur, Andhra Pradesh, India. Her area of interest in the field of power systems and electric Drives. Email: nirmala.yadav39@gmail.com



Shajida Shaik was born in Andhra Pradesh, India. She received the B.Tech degree in Electrical and Electronics Engineering from **DR SGIET**, A.P., in 2005 and **M.E** degree in **osmania** university, AP, in 2012. She is presently working as Asst.Professor Dept.EEE, Audisankara Institute of Technology-Gudur, Nellore, Andhrpradesh, India.



Mr. Jan Bhasha Shaik was born in Andhra Pradesh, India. He received the B.Tech degree in Electrical and Electronics Engineering from JNT University, Hyderabad in 2004 and M.Tech degree in Power & Industrial Drives from JNT University Kakinada in 2010. He is currently pursuing the Ph.D. degree at the JNT University, Anantapur, Andhra Pradesh, India. He had worked as an Assistant Professor and IEEE student Branch counselor at Hi-Tech College of Engineering, and worked as an Assistant professor at KL University Guntur, AP. Currently He is working as an Associate Professor at Audisankara Institute of Technology, Gudur, AP. He was the academic project coordinator for Under-Graduate & Post Graduate students. His areas of interest are HVDC, FACTS & SMART GRID.